


TYPICAL CONCRETE SLAB PIPE PROTECTION (Only for pipes below 600mm diameter)

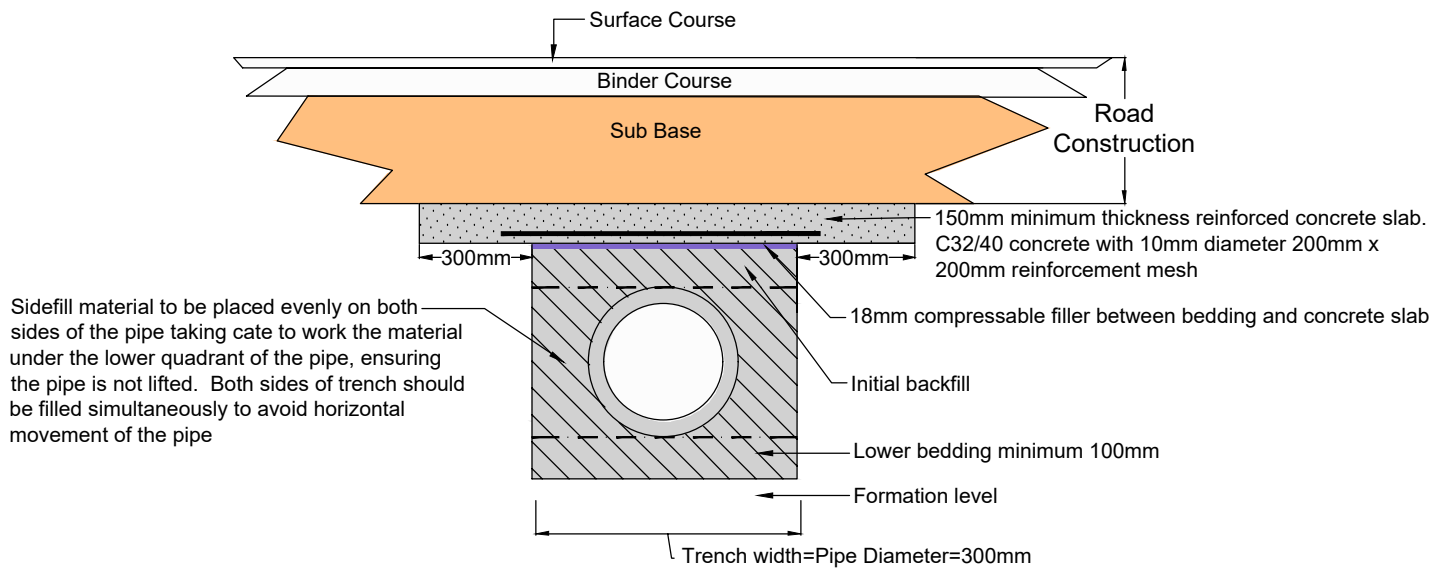

"Diameter of Pipe (mm)"	"Thickness of Compressible Filler (mm)*"
<450	18.000
450 - 1200	36.000
>1200	54.000

Rev:	Date:	Description:	Approved by:
AMENDMENT DETAILS			

Lincolnshire
COUNTY COUNCIL

Checked by:	--	Approved by:	--
-------------	----	--------------	----

DRAFT

-/-/-

Typical Concrete Slab
Pipe Protection

This is a typical detail and may require conversion to a full scheme specific drawing.

NOT TO SCALE
(all units in millimetres)

Disclaimer : Before making use of this detail, any designer or third party must ensure that it satisfies all requirements of the scheme to which it is being applied. Lincolnshire County Council accept no responsibility for third party use of this Standard Detail.

SD/5/136
Standard Detail Number

Revision Number